

# Shelby County Government

MARK H. LUTTRELL, JR.  
MAYOR

January 6, 2012

RE: Addendum RFP # 12-012-27, Data Cabling, Shelby County Trustee Office

Below are the answers to the questions ask during our pre-bid conference and walk thru inspection held at 9:00 AM, Friday, January 6, 2012.

1. All bidders are required to submit a 5% Bond with their bid.
2. All questions and answers will be posted to our web site within 24 hours of the bid opening.
3. Dimension of floors – Drawings attached of each floor
4. Distance of Fiber :

The following measurements are **APPROXIMATE** and do **NOT** account for slack on both ends of the run.

All of the buildings are available for measurement during regular business hours (8:30-4:00 M-F) Contact Nelson Fowler to arrange access.

12<sup>th</sup> floor Computer Room 160 North Main □ 3<sup>rd</sup> floor Comp Room 160 North Main - 370'

3<sup>rd</sup> floor Computer Room 160 North Main □ 160 north Main Basement Snack Bar Closet - 56'

160 North Main Basement Snack Bar Closet □ Fire Pump Room and Exterior of building -80'

Exterior of 160 North Main □ Exterior of 150 Washington - 126'

Exterior of 150 Washington □ 150 Washington Basement Computer Room + 25' slack loop □ to pull box in 157 Poplar basement/tunnel - 265'

157 Poplar Basement floor surface □ 157 Poplar 1<sup>st</sup> floor, floor surface - 14'


157 Poplar 1<sup>st</sup> floor, floor surface □ 157 Poplar 2<sup>nd</sup> floor, floor surface - 22'

157 Poplar 2<sup>nd</sup> floor, floor surface □ 157 Poplar 3<sup>rd</sup> floor, floor surface - 14'

157 Poplar 3<sup>rd</sup> floor, floor surface □ 157 Poplar 4<sup>th</sup> floor, floor surface -14'


5. Leave 25 ft. slack loop of Single Mode Fiber in the basement telecommunications room at 150 Washington
6. Dates for Installation
  - a. Single Fiber – February 10
  - b. Cat 6 –
    - i. 1<sup>st</sup> Floor – February 10
    - ii. 2<sup>nd</sup>, 3<sup>rd</sup> and 4<sup>th</sup> Floors – March 1

Thank you,

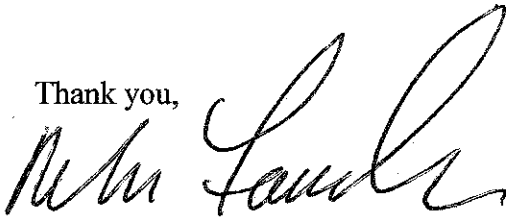A handwritten signature in black ink, appearing to read "Nelson Fowler", written in a cursive style.


Nelson Fowler, Manager A  
Shelby County Government  
901-222-2251

Cc: Leslie Pannell, Trustees Office  
Steve Solaas, Information Technology  
RFP File 12-012-27

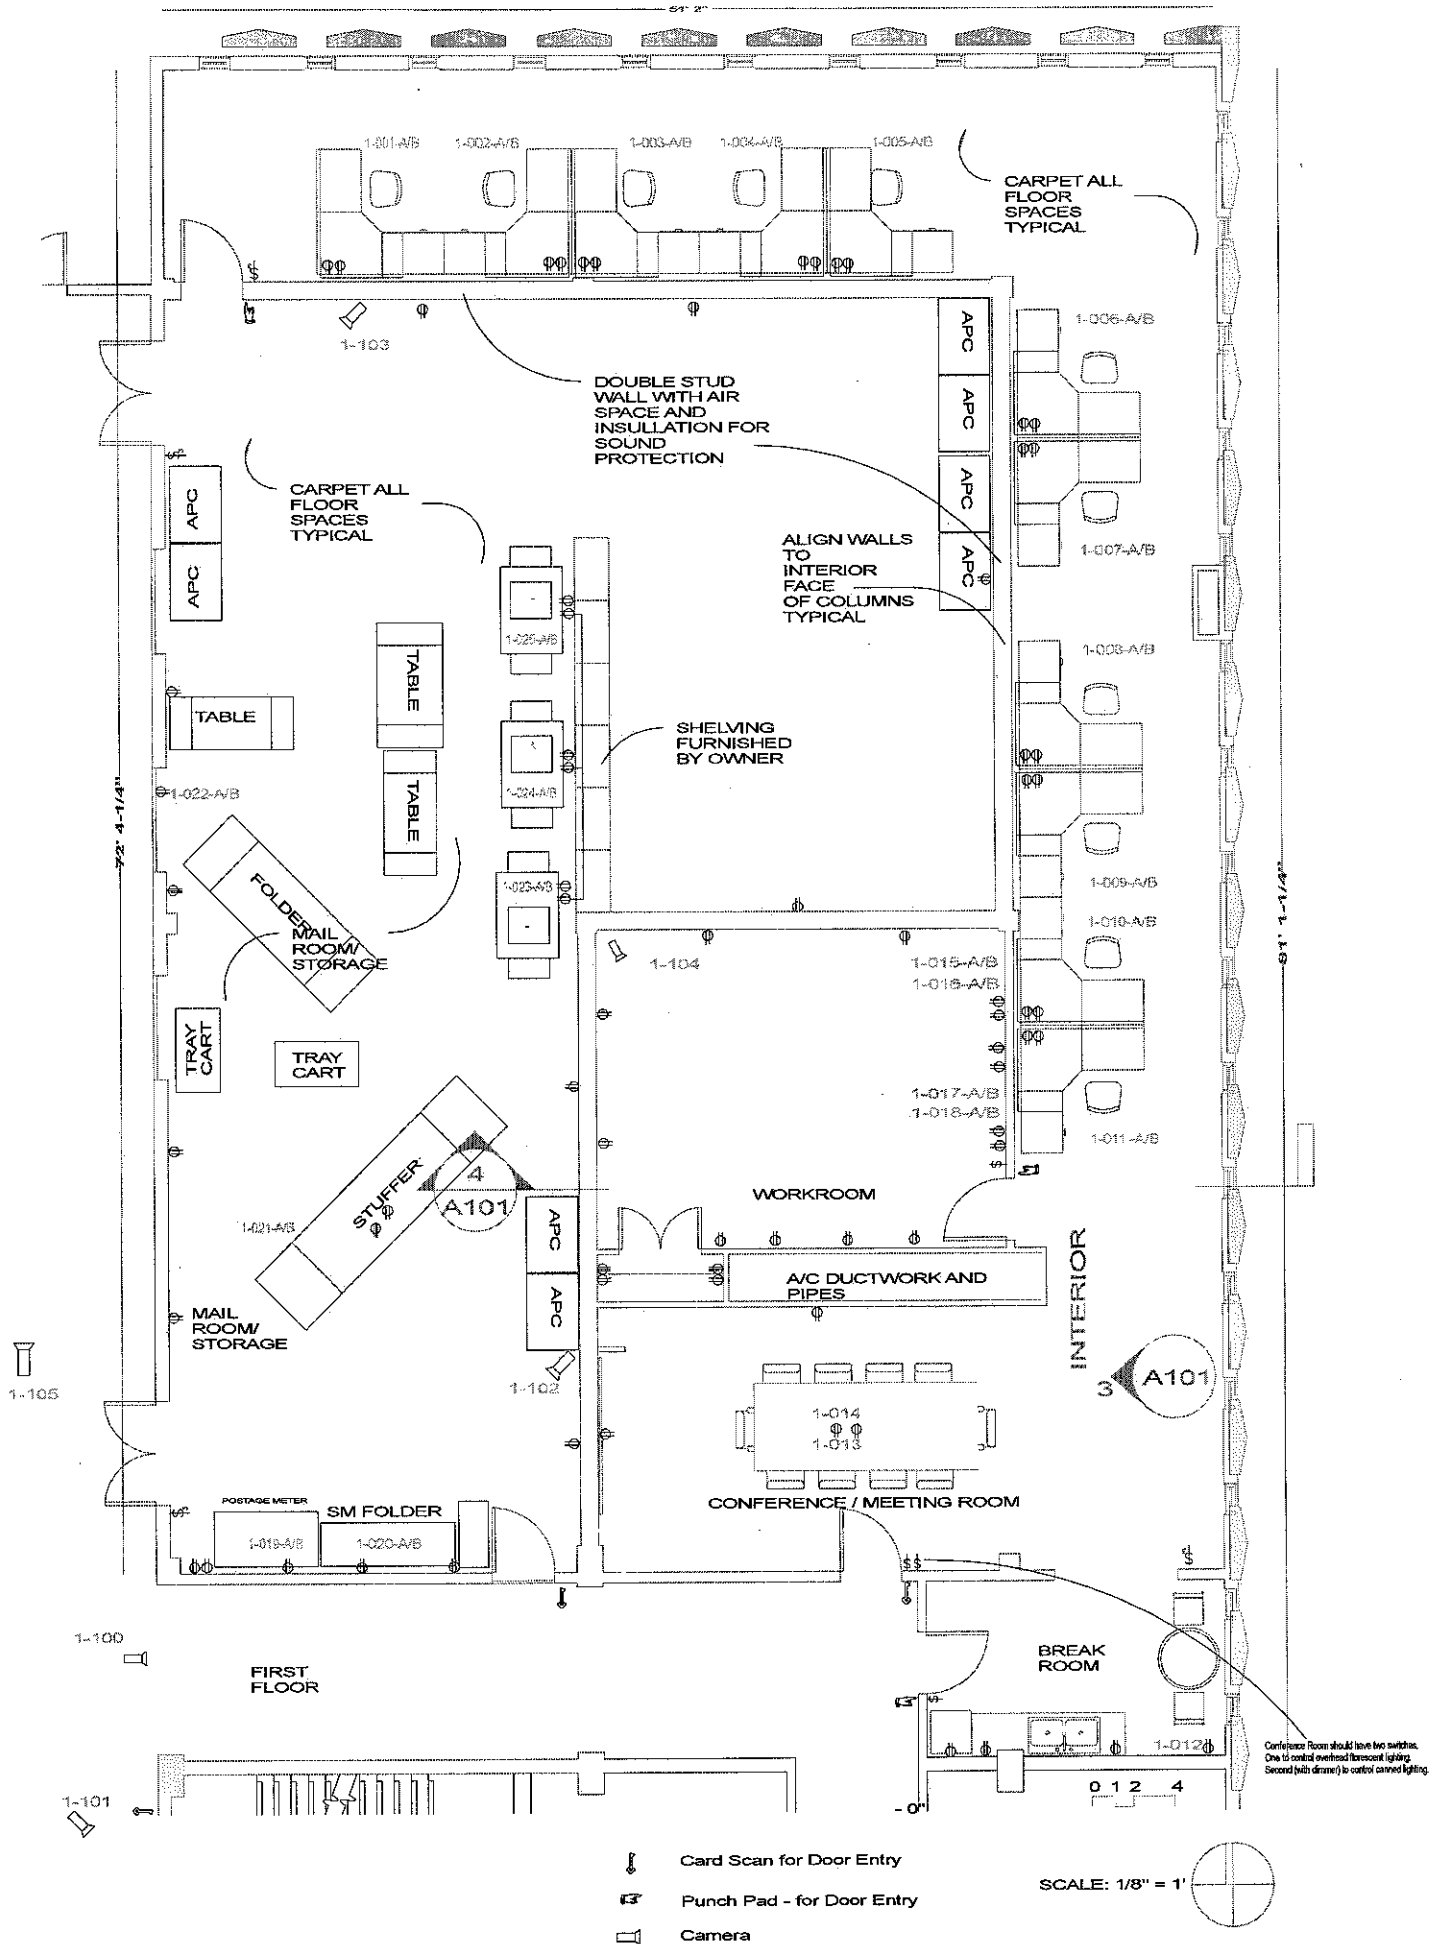

Conference Room should have two switches.  
One to control overhead fluorescent lighting.  
Second (with dimmer) to control recessed lights.

OVERHEAD POWER

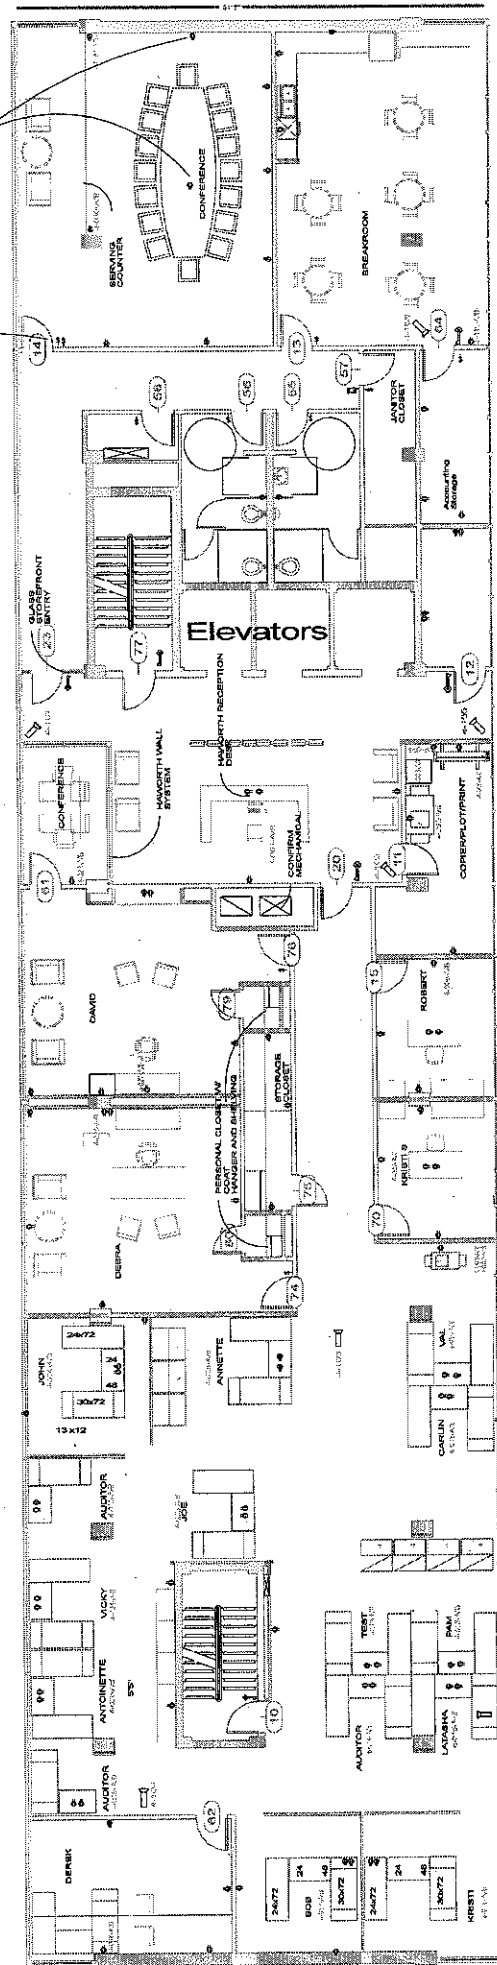


#### 4th Floor Legend

- Card Scan for Door Entry
- Punch Pad for Door Entry
- Camera

Overhead Power

Conference Room should have two outlets.  
One to control overhead fluorescent lighting  
Second (with dimmer) to control dimmed lighting.

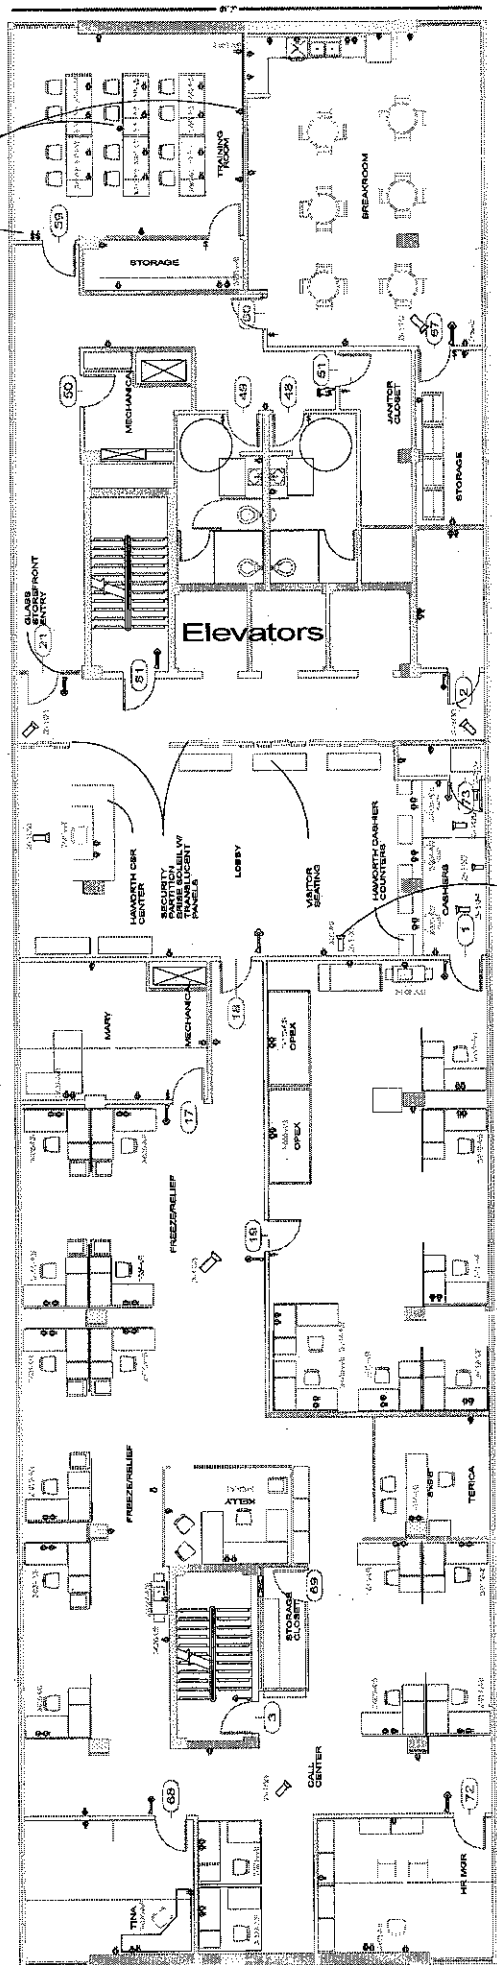


Kiosk with Camera???

### 2nd Floor Legend

- Card Down for Door Entry
- Punch Pad for Door Entry
- Camera

Conference Room should have two switches.  
One to control overhead fluorescent lighting.  
Second (with dimmer) to control canned lighting.

OVERHEAD POWER

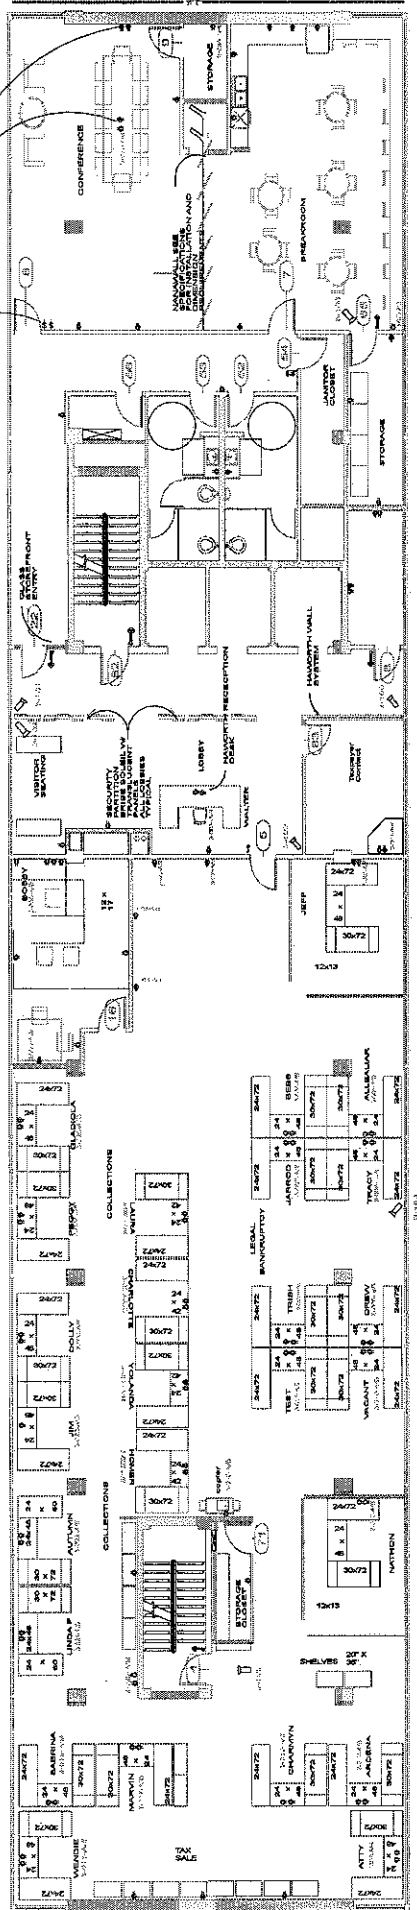

### 3rd Floor Legend

- ← Card Scan for Door Entry
- ⬆ Punch Pad for Door Entry
- Camera